

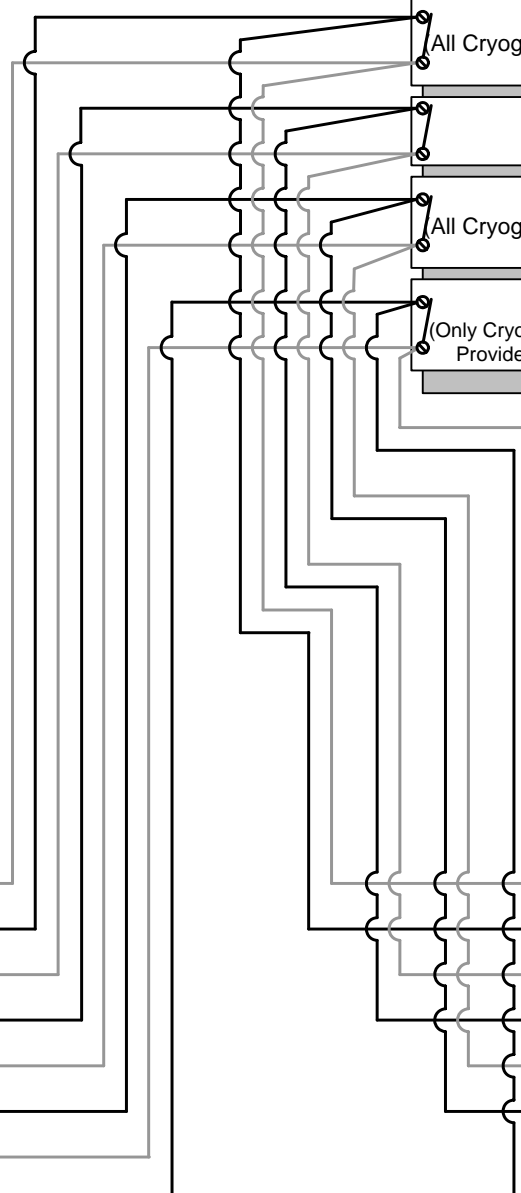
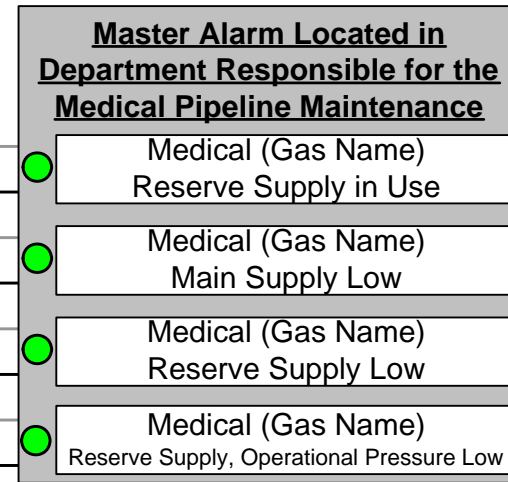


This document is not to be reproduced, distributed, used or disclosed, either in whole or part, except as specifically authorized by Life Medical Networks, Inc. and Craig Williams.

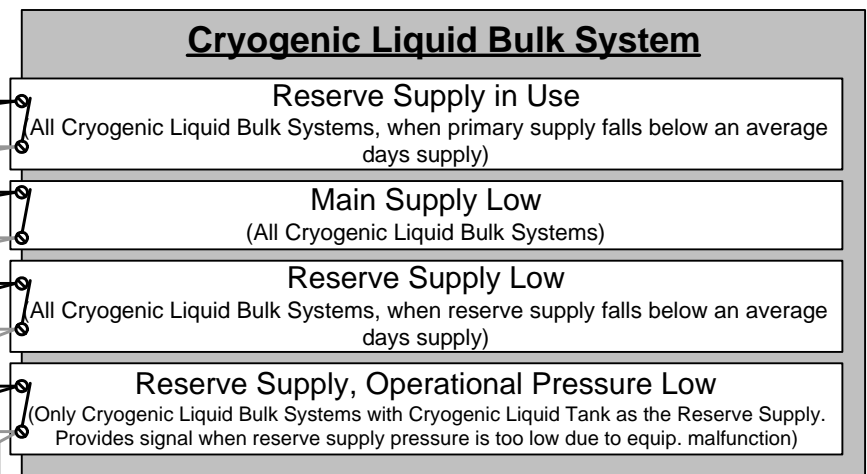

5450 Dunwoody Mill Ct.  
Atlanta, GA 30360  
Ph. 770 551-9066  
Fax 770 551-9631  
cbwi2l@bellsouth.net

**Required Alarm Wiring  
Medical Gas Manifolds**

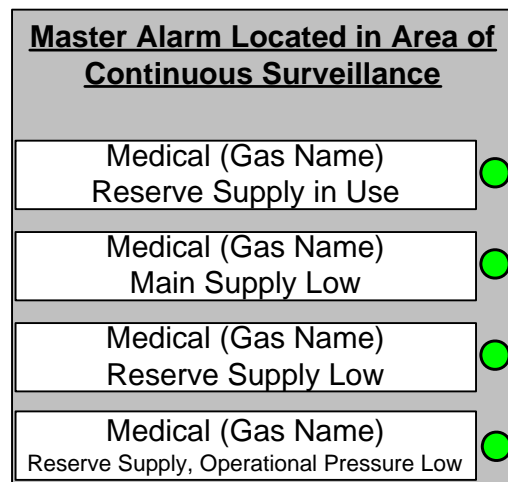


This document is not to be reproduced, distributed, used or disclosed, either in whole or part, except as specifically authorized by Life Medical Networks, Inc. and Craig Williams.



5450 Dunwoody Mill Ct.  
Atlanta, GA 30360  
Ph. 770 551-9066  
Fax 770 551-9631  
cbwi2l@bellsouth.net

**Required Alarm Wiring Bulk Liquid Systems**

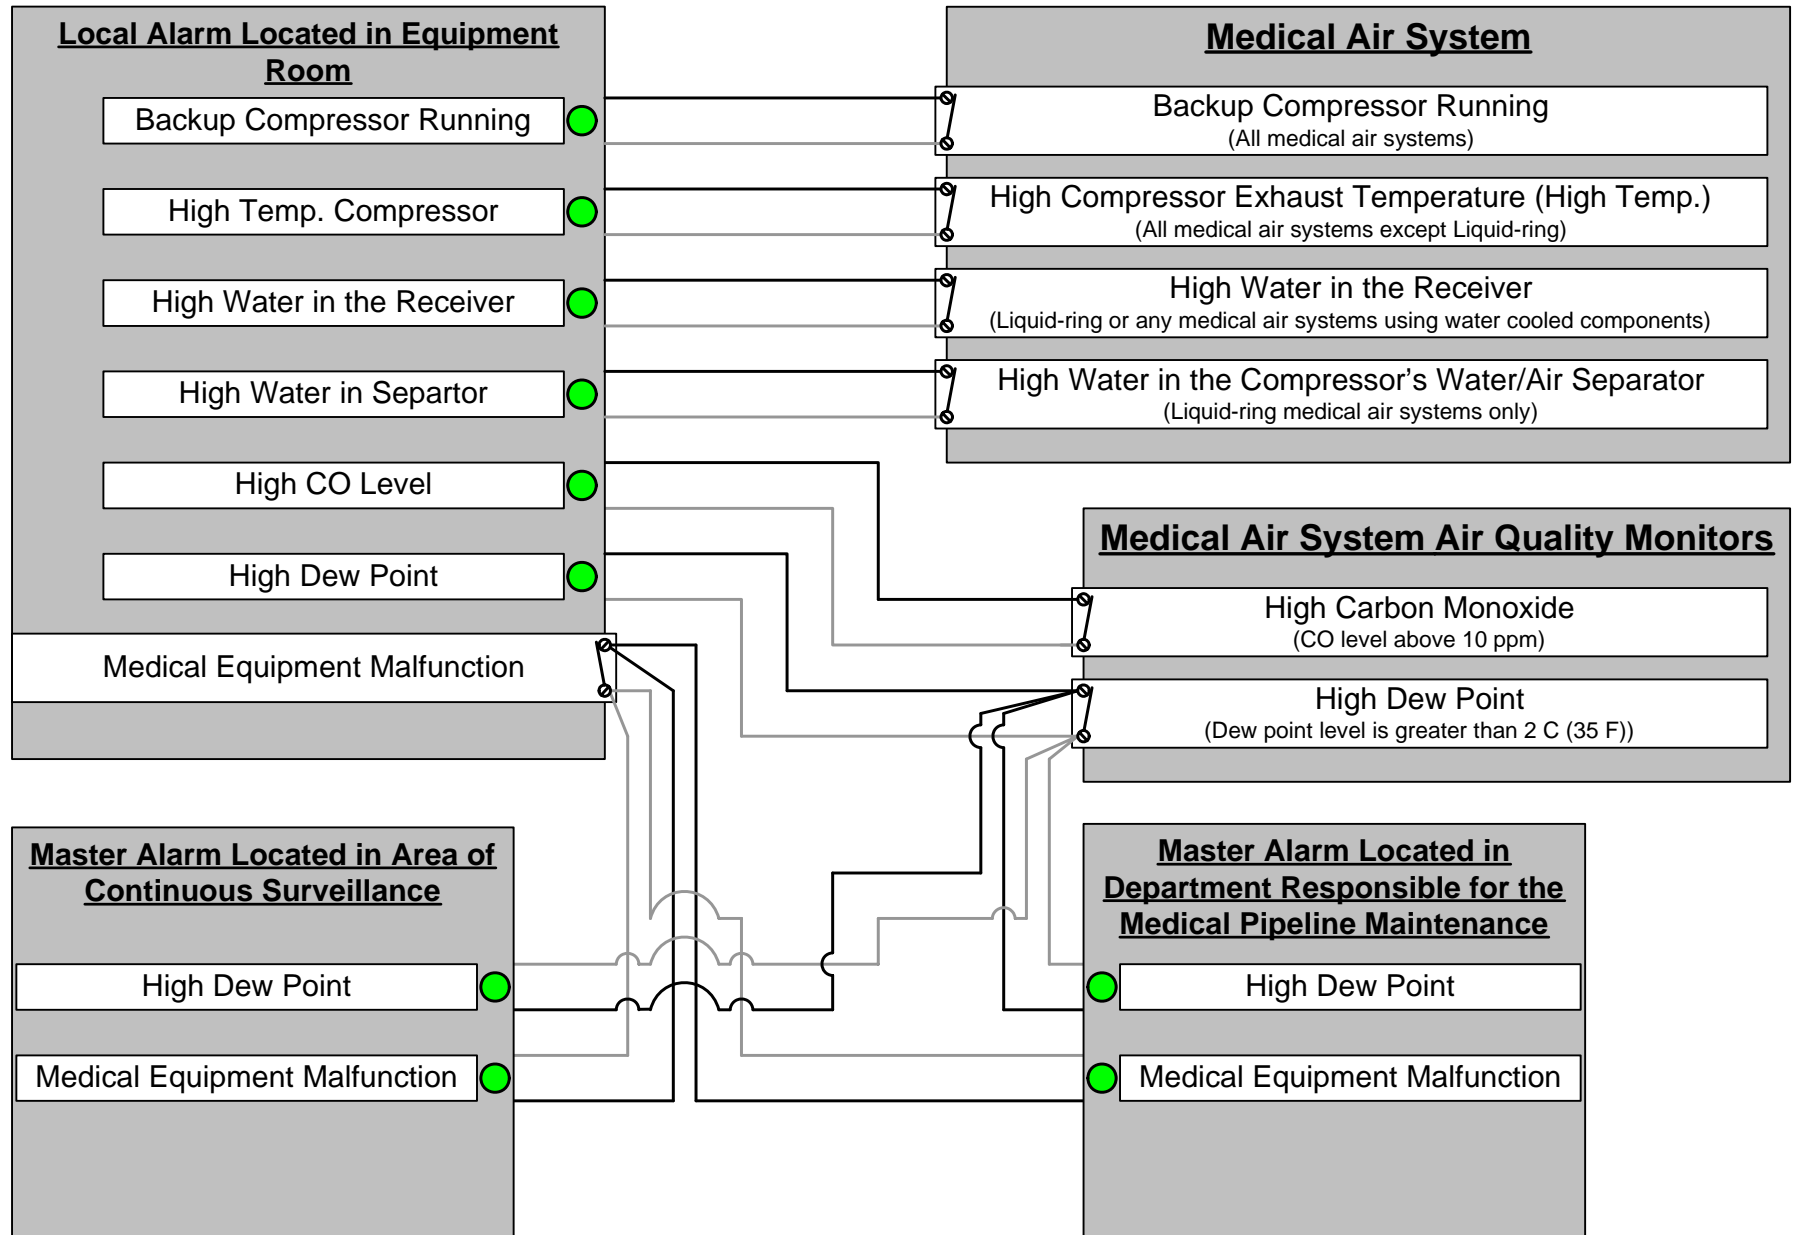


This document is not to be reproduced, distributed, used or disclosed, either in whole or part, except as specifically authorized by Life Medical Networks, Inc. and Craig Williams.



5450 Dunwoody Mill Ct.  
 Atlanta, GA 30360  
 Ph. 770 551-9066  
 Fax 770 551-9631  
 cbwi2l@bellsouth.net

**Required Alarm Wiring  
 Medical Air System**

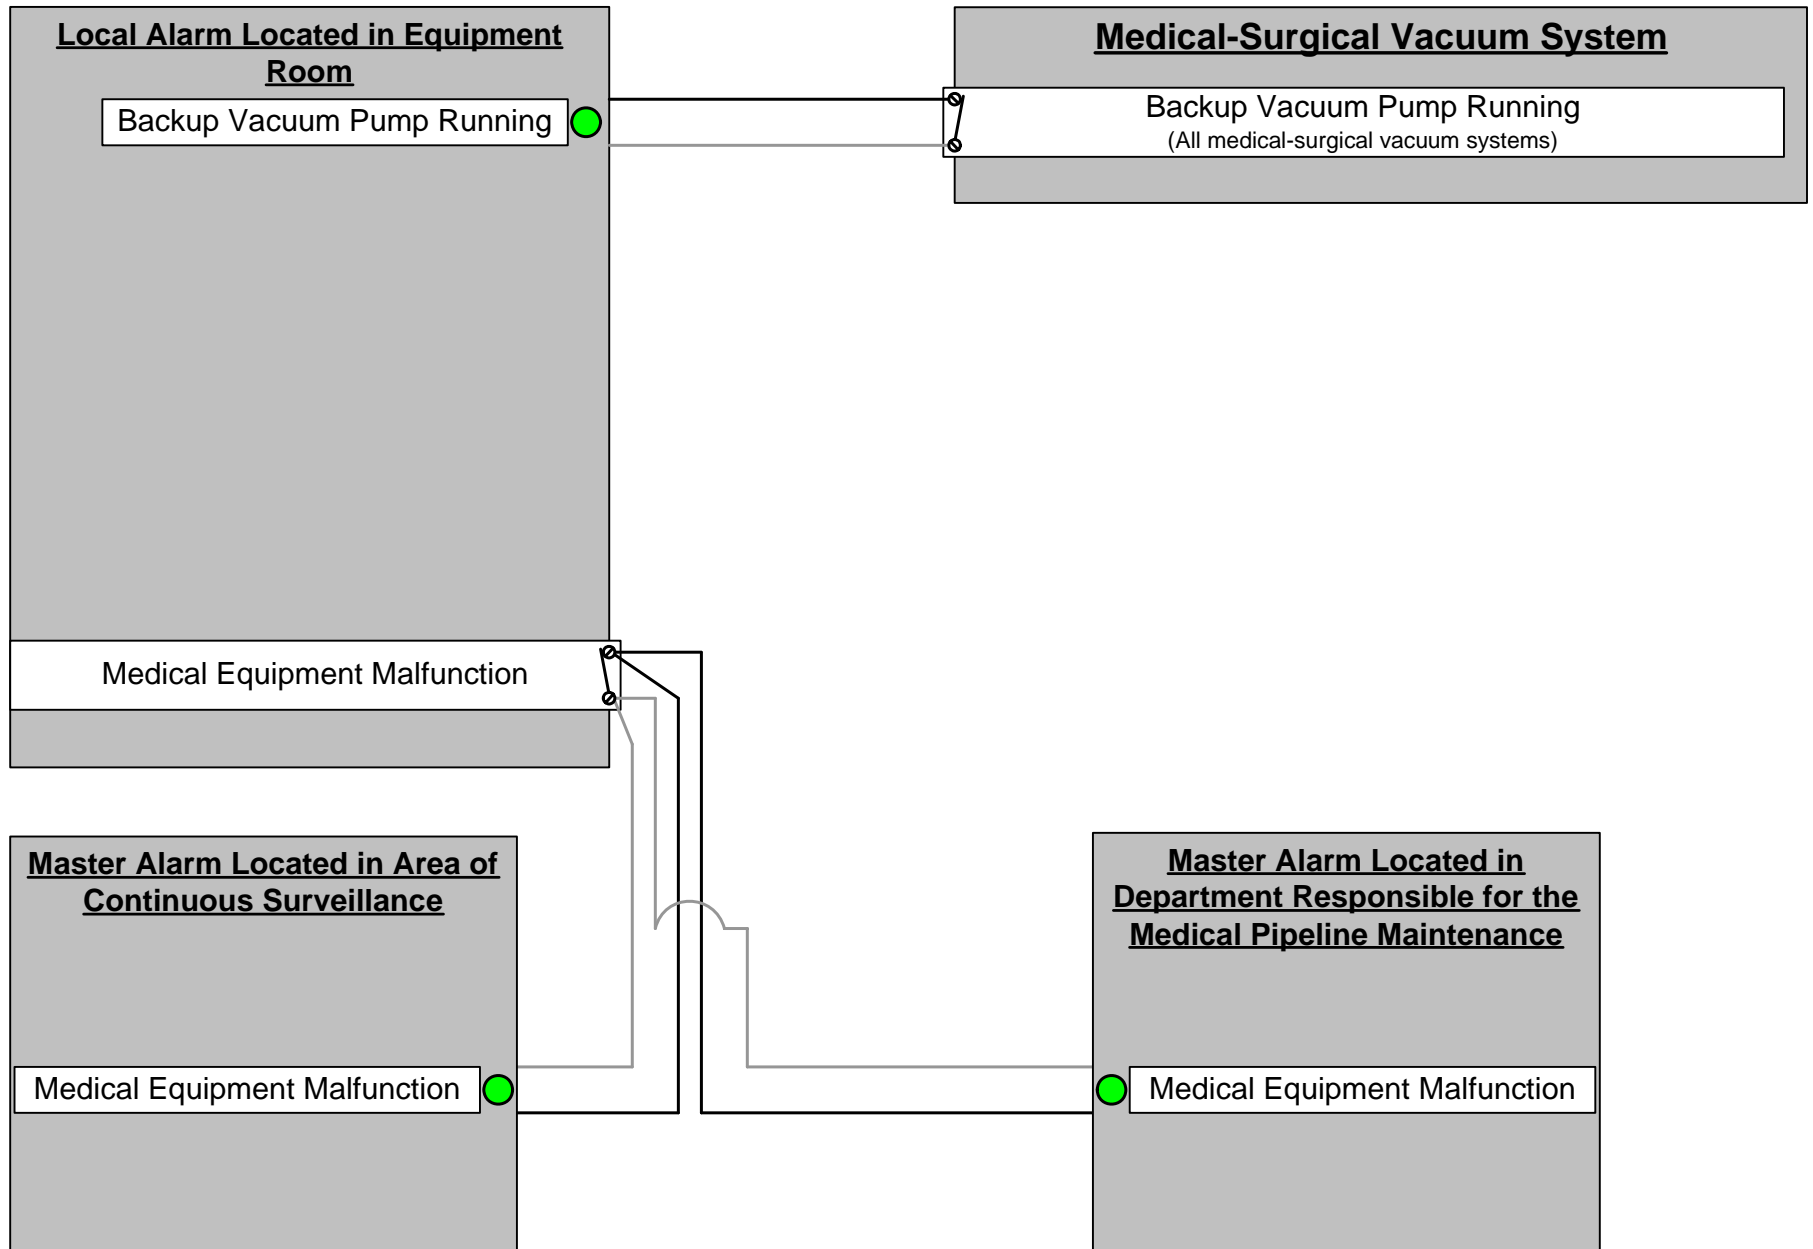


This document is not to be reproduced, distributed, used or disclosed, either in whole or part, except as specifically authorized by Life Medical Networks, Inc. and Craig Williams.



5450 Dunwoody Mill Ct.  
Atlanta, GA 30360  
Ph. 770 551-9066  
Fax 770 551-9631  
cbwi2l@bellsouth.net

**Required Alarm Wiring  
Medical-Surgical  
Vacuum System**

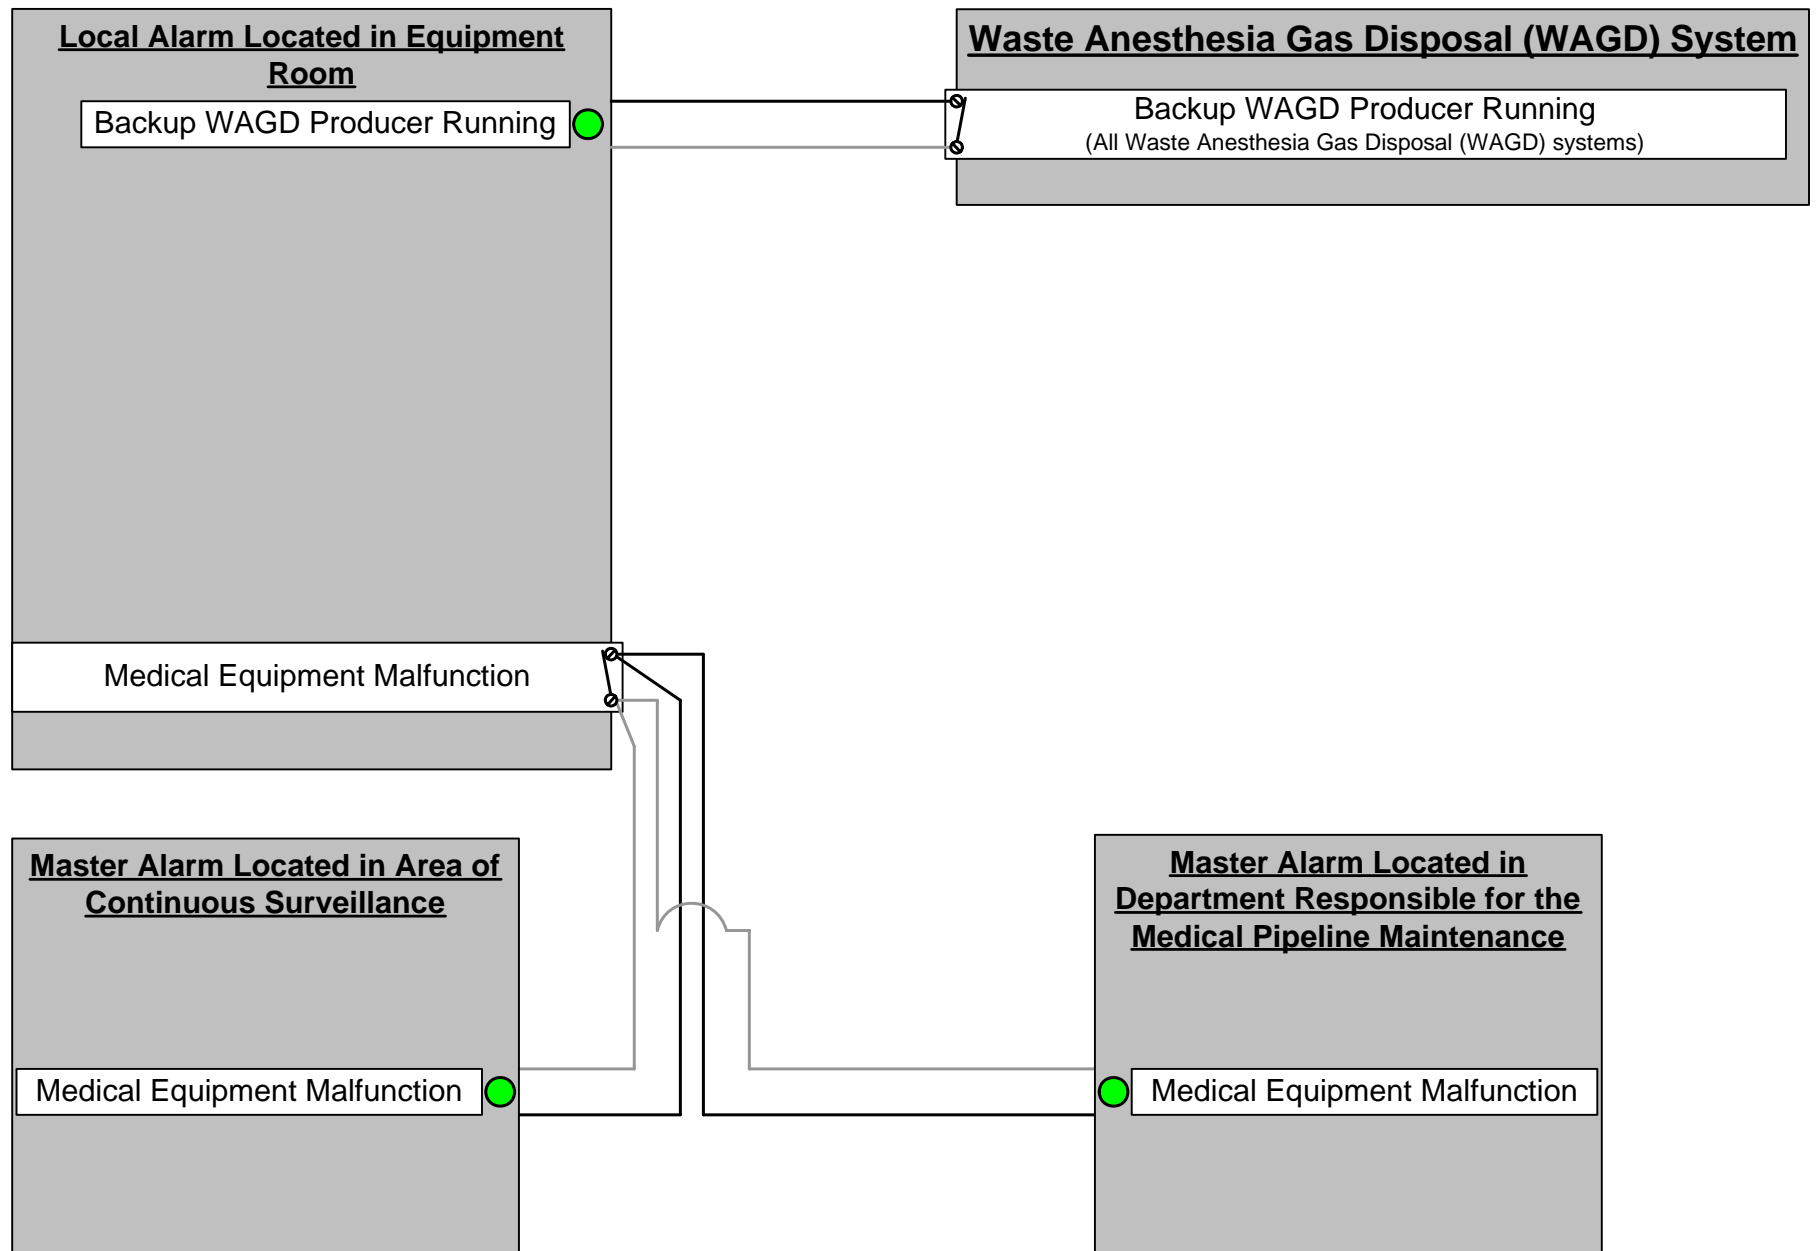


This document is not to be reproduced, distributed, used or disclosed, either in whole or part, except as specifically authorized by Life Medical Networks, Inc. and Craig Williams.



5450 Dunwoody Mill Ct.  
Atlanta, GA 30360  
Ph. 770 551-9066  
Fax 770 551-9631  
cbwi2l@bellsouth.net

**Required Alarm Wiring  
WAGD System**

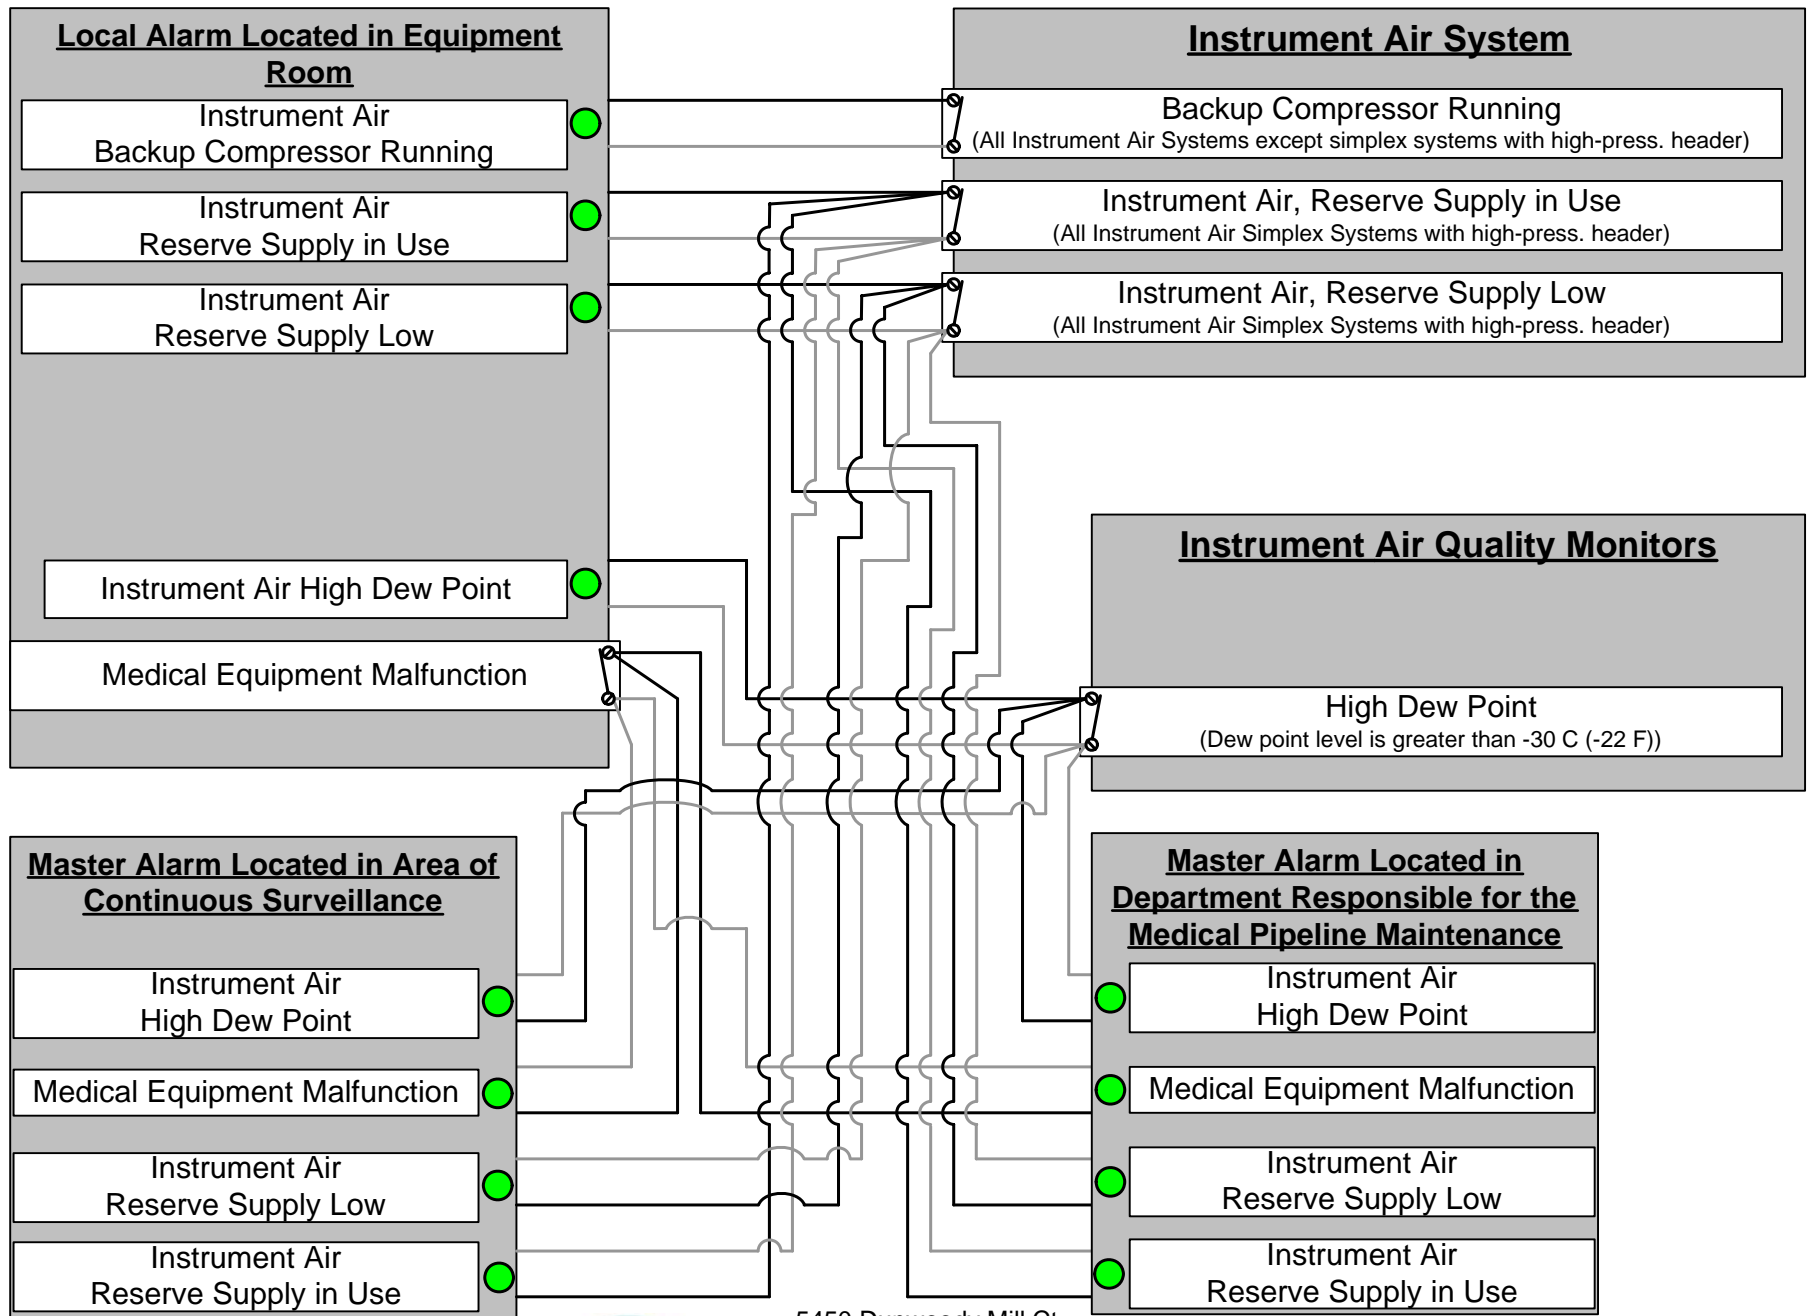

This document is not to be reproduced, distributed, used or disclosed, either in whole or part, except as specifically authorized by Life Medical Networks, Inc. and Craig Williams.



5450 Dunwoody Mill Ct.  
 Atlanta, GA 30360  
 Ph. 770 551-9066  
 Fax 770 551-9631  
 cbwi2l@bellsouth.net

**Required Alarm Wiring  
 Instrument Air System**